


## Industrial 1.25Gbps SFP Transceiver

**Особенности:**

- Industrial: -40°C~+85°C
- до 20 км на 9/125 μm SMF
- 1310nm FP лазер + PIN фотоприемник
- цифровая диагностика (DDMI) в соответствии с SFF-8472
- соответствие спецификации SFP MSA
- возможность горячей замены
- двойной LC разъем

**Области применения:**

- Gigabit Ethernet 1000Base-LX
- STM-4

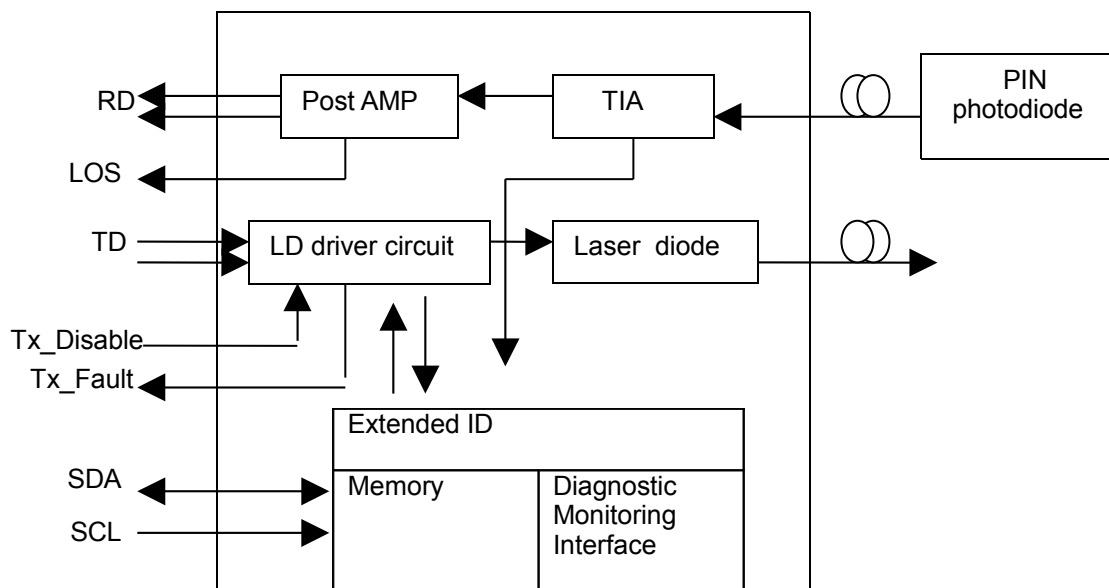**Функциональная схема:**

## Recommended Operating Conditions

Parameter		Symbol	Min.	Typical	Max.	Unit
		SFP-1.25G-20-DI	-40		+85	
Power Supply Voltage		$V_{CC}$	3.15	3.3	3.45	V
Power Supply Current		$I_{CC}$			300	mA
Date Rate	GBE			1.25		Gbps

## Performance Specifications - Electrical

Parameter		Symbol	Min.	Typ.	Max	Unit	Notes
<b>Transmitter</b>							
LVPECL Inputs(Differential)		$V_{in}$	400		2000	mVpp	AC coupled inputs <sup>*(note5)</sup>
Input Impedance (Differential)		$Z_{in}$	85	100	115	ohms	$R_{in} > 100 \text{ kohms @ DC}$
Tx_Dis	Disable		2		$V_{CC}$	V	
	Enable		0		0.8		
Tx_FAULT	Fault		2		$V_{CC}+0.3$	V	
	Normal		0		0.5		
<b>Receiver</b>							
LVPECL Outputs (Differential)		$V_{out}$	400		2000	mVpp	AC coupled outputs <sup>*(note5)</sup>
Output Impedance (Differential)		$Z_{out}$	85	100	115	ohms	
Rx_LOS	LOS		2		$V_{CC}+0.3$	V	
	Normal		0		0.8	V	
MOD_DEF ( 0:2 )	VoH		2.5			V	With Serial ID
	VoL		0		0.5	V	

## Optical and Electrical Characteristics

Parameter		Symbol	Min.	Typical	Max.	Unit
9µm Core Diameter SMF		L		20		km
Data Rate				1.25		Gbps
<b>Transmitter</b>						
Centre Wavelength		$\lambda_C$	1260	1310	1360	nm
Spectral Width (RMS)		$\Delta\lambda$			3	nm
Average Output Power <sup>*(note3)</sup>		$P_{out}$	-8		-3	dBm
Extinction Ratio <sup>*(note4)</sup>		ER	9			dB
Rise/Fall Time(20% ~ 80%)		$t_r/t_f$			0.26	ns
Total Jitter		TJ			0.43	UI
Output Optical Eye <sup>*(note4)</sup>		Compliant with IEEE 802.3ah-2004 <sup>*(note7)</sup>				
TX_Disable Assert Time		$t_{off}$			10	us
Pout@TX Disable Asserted		$P_{out}$			-45	dBm

Receiver					
Centre Wavelength	$\lambda$	1260		1600	nm
Receiver Sensitivity*(note6)	Pmin			-22	dBm
Receiver Overload	Pmax	-3			dBm
LOS De-Assert	LOSD			-23	dBm
LOS Assert	LOSA	-42			dBm
LOS Hysteresis*(note8)		0.5			dB

Note3: Output is coupled into a 9/125 $\mu$ m single-mode fiber.



Note4: Filtered, measured with a PRBS 2<sup>7</sup>-1 test pattern @1.25Gbps

Note5: LVPECL logic, internally AC coupled.


Note6: Minimum average optical power at BER less than 1E-12, with a 2<sup>7</sup>-1 NRZ PRBS and ER=9 dB.

Note7: Eye pattern mask


Note8: LOS Hysteresis

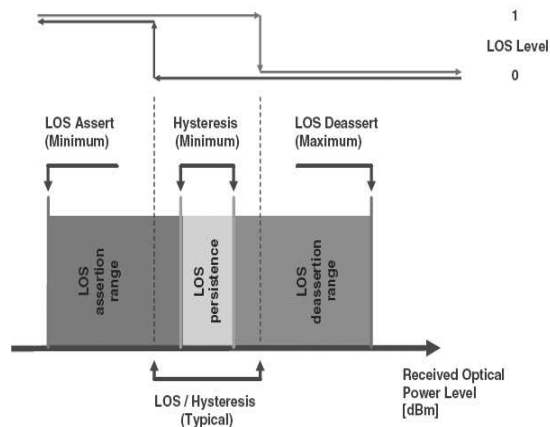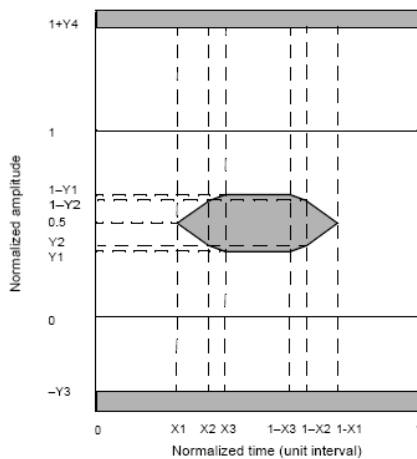


## Functional Description of Transceiver

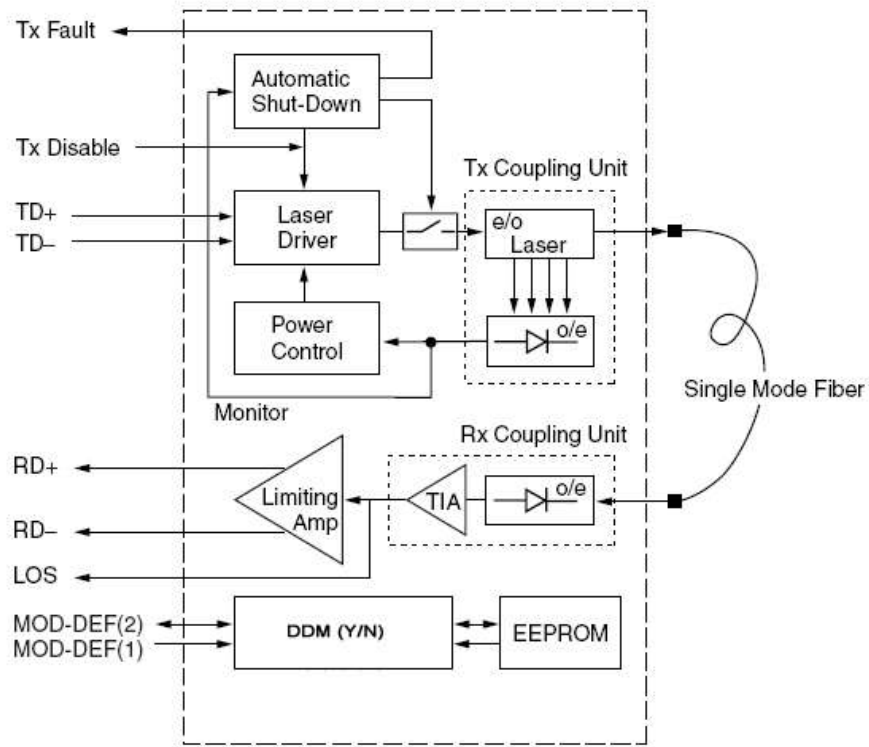

### SFP Transceiver Electrical Pad Layout

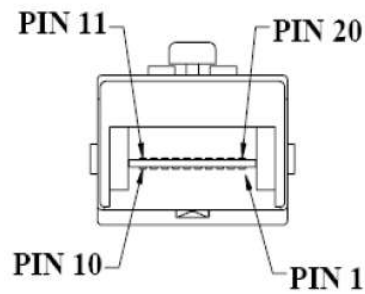

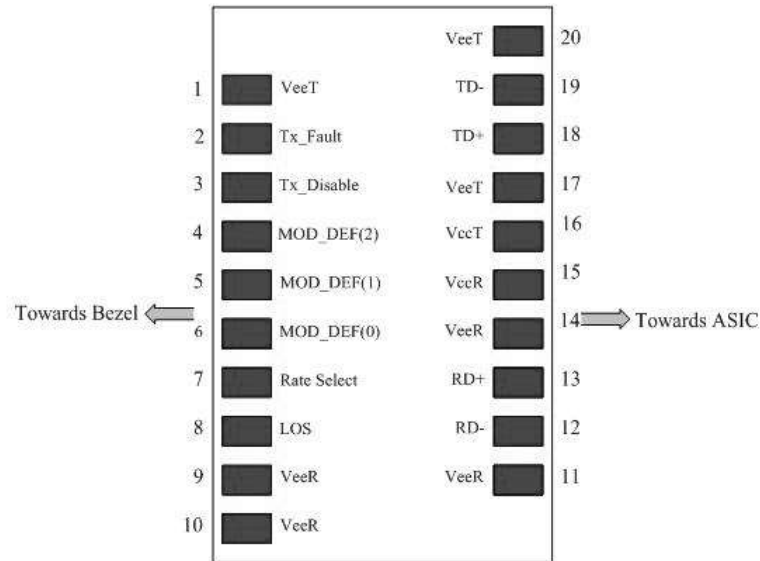

## Pin Function Definitions

Pin Num.	Name	Function	Plug	Notes
1	VeeT	Transmitter Ground	1	5)
2	TX Fault	Transmitter Fault Indication	3	1)
3	TX Disable	Transmitter Disable	3	2) Module disables on high or open
4	MOD-DEF2	Module Definition 2	3	3) Data line for Serial ID.
5	MOD-DEF1	Module Definition 1	3	3) Clock line for Serial ID.
6	MOD-DEF0	Module Definition 0	3	3) Grounded within the module.
7	Rate Select	Not Connect	3	Function not available
8	LOS	Loss of Signal	3	4)
9	VeeR	Receiver Ground	1	5)
10	VeeR	Receiver Ground	1	5)
11	VeeR	Receiver Ground	1	5)
12	RD-	Inv. Received Data Out	3	6)
13	RD+	Received Data Out	3	7)
14	VeeR	Receiver Ground	1	5)
15	VccR	Receiver Power	2	7) 3.3 ± 5%
16	VccT	Transmitter Power	2	7) 3.3 ± 5%
17	VeeT	Transmitter Ground	1	5)
18	TD+	Transmit Data In	3	8)
19	TD-	Inv. Transmit Data In	3	8)
20	VeeT	Transmitter Ground	1	5)

**Notes:**


- 1) TX Fault is an open collector/drain output, which should be pulled up with a 4.7K – 10K $\Omega$  resistor on the host board. Pull up voltage between 2.0V and VccT, R+0.3V. When high, output indicates a laser fault of some kind. Low indicates normal operation. In the low state, the output will be pulled to < 0.8V.
- 2) TX disable is an input that is used to shut down the transmitter optical output. It is pulled up within the module with a 4.7 – 10 K $\Omega$  resistor. Its states are:  
Low (0 – 0.8V): Transmitter on  
(>0.8, < 2.0V): Undefined  
High (2.0 – 3.465V): Transmitter Disabled  
Open: Transmitter Disabled
- 3) Modulation Absent, connected to VEET or VEER in the module.
- 4) LOS (Loss of Signal) is an open collector/drain output, which should be pulled up with a 4.7K – 10K $\Omega$  resistor. Pull up voltage between 2.0V and VccT, R+0.3V. When high, this output indicates the received optical power is below the worst-case receiver sensitivity (as defined by the standard in use). Low indicates normal operation. In the low state, the output will be pulled to < 0.8V.
- 5) VeeR and VeeT may be internally connected within the SFP module.
- 6) RD-/+: These are the differential receiver outputs. They are AC coupled 100 $\Omega$  differential lines which should be terminated with 100 $\Omega$  (differential) at the user SERDES. The AC coupling is done inside the module and is thus not required on the host board. The voltage swing on these lines will be between 400 and 2000 mV differential (200 –1000 mV single ended) when properly terminated.
- 7) VccR and VccT are the receiver and transmitter power supplies. They are defined as 3.3V  $\pm$ 5% at the SFP connector pin. Maximum supply current is 300mA. Recommended host board power supply filtering is shown below. Inductors with DC resistance of less than 1 ohm should be used in order to maintain the required voltage at the SFP input pin with 3.3V supply voltage. When the recommended supply-filtering network is used, hot plugging of the SFP transceiver module will result in an inrush current of no more than 30mA greater than the steady state value. VccR and VccT may be internally connected within the SFP transceiver module.
- 8) TD-/+: These are the differential transmitter inputs. They are AC-coupled, differential lines with 100 $\Omega$  differential termination inside the module. The AC coupling is done inside the module and is thus not required on the host board. The inputs will accept differential swings of 400 – 2000mV (200 – 1000mV single-ended).

**EEPROM**

The serial interface uses the 2-wire serial CMOS EEPROM protocol defined for the ATMEL AT24C02/04 family of components. When the serial protocol is activated, the host generates the serial clock signal (SCL). The positive edge clocks data into those segments of the EEPROM that are not

write-protected within the SFP transceiver. The negative edge clocks data from the SFP transceiver. The serial data signal (SDA) is bi-directional for serial data transfer. The host uses SDA in conjunction with SCL to mark the start and end of serial protocol activation. The memories are organized as a series of 8-bit data words that can be addressed individually or sequentially.

The Module provides diagnostic information about the present operating conditions. The transceiver generates this diagnostic data by digitization of internal analog signals. Calibration and alarm/warning threshold data is written during device manufacture. Received power monitoring, transmitted power monitoring, bias current monitoring, supply voltage monitoring and temperature monitoring all are implemented. If the module is defined as external calibrated, the diagnostic data are raw A/D values and must be converted to real world units using calibration constants stored in EEPROM locations 56 – 95 at wire serial bus address A2H. The digital diagnostic memory map specific data field define as following .For detail EEPROM information, please refer to the related document of SFF 8472 Rev 9.3.

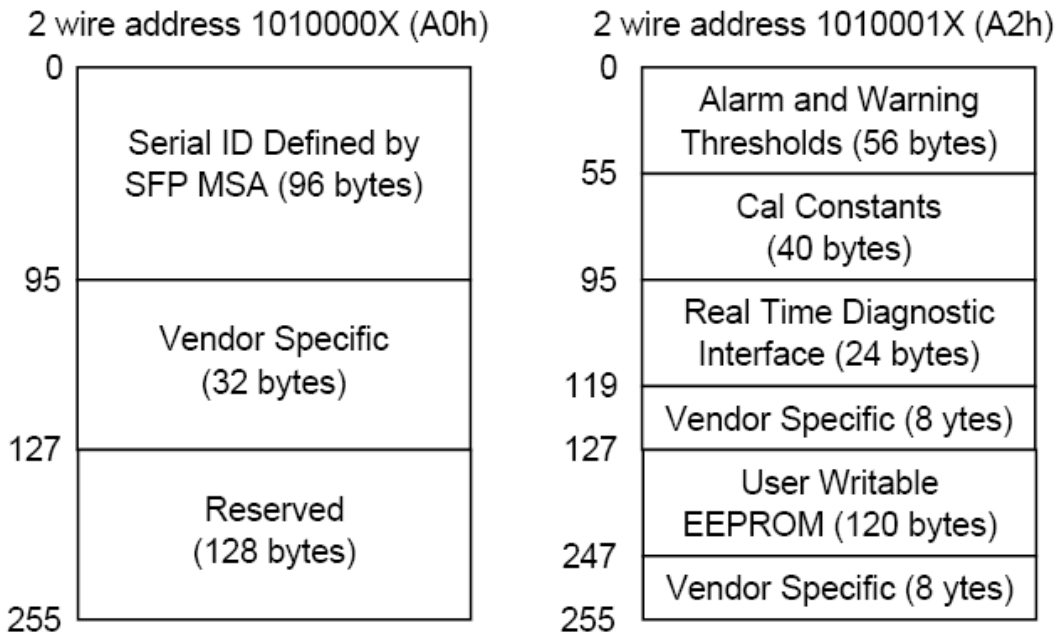

### EEPROM Serial ID Memory Contents

Accessing Serial ID Memory uses the 2 wire address 1010000X(A0H). Memory Contents of Serial ID are shown in Table 1.

**Table 1 Serial ID Memory Contents**




Add.	Size (Bytes)	Name of Field	Hex	Description
<b>BASE ID FIELDS</b>				
0	1	Identifier	03	SFP
1	1	Ext. Identifier	04	SFP function is defined by serial ID only

2	1	Connector	07	LC Connector
3-10	8	Transceiver	XX <sup>(note9)</sup>	Transmitter Code
11	1	Encoding	01	8B10B
12	1	BR, Nominal	0D	1.25Gbps
13	1	Reserved	00	
14	1	Length (9μm) km	0A/0F/14/1E/28	Transceiver Transmit Distance
15	1	Length(9μm) 100m	64/96/C8/FF/FF	
16	1	Length (50μm) 10m	00	
17	1	Length(62.5μm)10m	00	
18	1	Length (Copper)	00	Not Compliant
19	1	Reserved	00	
20-35	16	Vendor name	XX XX XX XX XX XX XX XX <sup>(note9)</sup> 20 20 20 20 20 20 20 20	Vendor name (ASCII)
36	1	Reserved	00	
37-39	3	Vendor OUI	00 00 00	
40-55	16	Vendor PN	XX XX XX XX XX XX XX XX XX XX XX XX XX XX XX XX	Transceiver part number
56-59	4	Vendor rev	XX XX XX XX <sup>(note9)</sup>	ASCII (31 30 20 20 means 1.0 revision )
60-61	2	Wavelength	05 1E	1310nm
62	1	Reserved	00	
63	1	CC_BASE	Check Sum (Variable)	Check Code for Base ID Fields
<b>EXTENDED ID FIELDS</b>				
64-65	2	Options	00 1A	TX_DISABLE, TX_FAULT and Loss of Signal implemented.
66	1	BR, max	00	
67	1	BR, min	00	
68-83	16	Vendor SN	XX XX XX XX XX XX XX XX 20 20 20 20 20 20 20 20 <sup>(note9)</sup>	Serial Number of transceiver (ASCII). For example "B000822".
84-91	8	Date Code	XX XX XX XX XX XX XX XX <sup>(note9)</sup>	Manufactory date code. For example "080405".
92	1	Diagnostic Monitoring Type	XX <sup>(note9)</sup>	Digital Diagnostic Monitoring Implemented
93	1	Enhanced Options	XX <sup>(note9)</sup>	Optional Flags
94	1	SFF_8472 Compliance	XX <sup>(note9)</sup>	01 for Rev9.3 SFF-8472.
95	1	CC_EXT	Check Sum (Variable)	Check Sum for Extended ID Field.
<b>VENDOR SPECIFIC ID FIELDS</b>				
96-127	32	Vendor Specific	Read Only	Depends on Customer Information
128-255	128	Reserved	Read Only	

Note9: The "XX" byte should be filled in according to practical case. For more information, please refer to the related document of SFP Multi-Source Agreement (MSA).



Mechanical Specifications

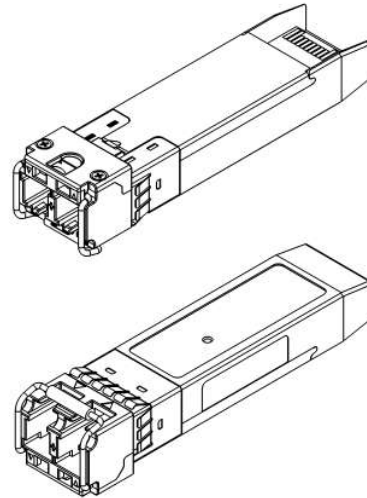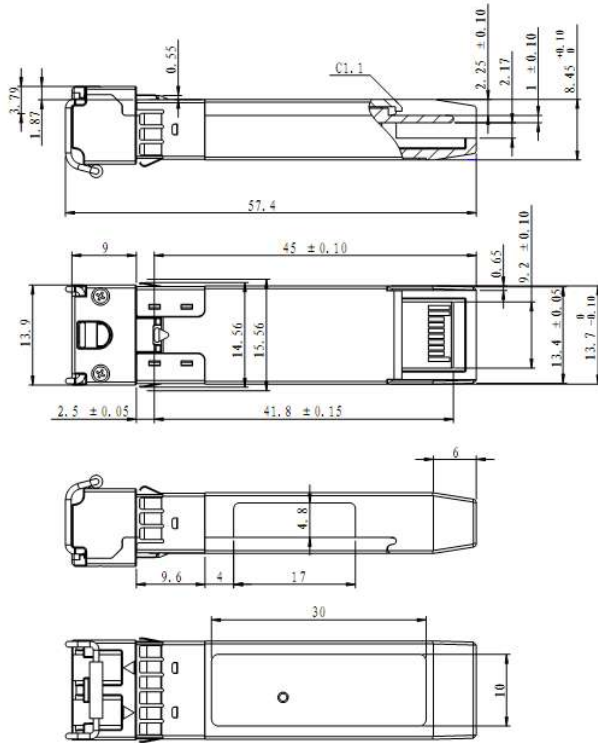

Laser Emission

